



**Lake Havasu City Fire Department**  
**Fire Prevention Bureau**  
**2330 McCulloch Blvd. N.**  
**Lake Havasu City, AZ 86403**  
**Phone: (928) 855-1141 Fax: (928) 453-3312**  
**www.lhcaz.gov**

---

**FD Specification #01**                      **IFC 2012, Ch. 5**  
**Fire Apparatus Access & Marking of Fire Lanes**

---

**Rev. 8/24/2016**  
**Page 1 of 5**

## **OVERVIEW**

Lake Havasu City Code § 10.12.080 curb markings and signs restricting parking, and Arizona Revised Statute § 28.873 prohibit the parking of vehicles in designated safety areas including fire lanes, access ways and roadways.

## **SCOPE**

Fire department access and fire lanes must be identified on the approved site plans for new developments or on the approved building plans for tenant improvements or residential projects. The Fire Marshal (FM) may determine the need for additional requirements, or may approve alternate methods of compliance with these standards.

## **PURPOSE**

The purpose of this fire department specification is to provide in detail the minimum requirements for the marking of fire apparatus access road(s). See International Fire Code § 503 Fire Apparatus Access Roads for fire apparatus access road requirements.  
[http://premiumaccess.iccsafe.org/document/code/332/5438869?code\\_id=5438869](http://premiumaccess.iccsafe.org/document/code/332/5438869?code_id=5438869)

## **DEFINITIONS**

**Fire Apparatus Access Road** – A road that provides fire apparatus access from a fire station to a facility, building, or portion thereof. This is a general term inclusive of all other terms such as fire lane, Public Street, Private Street, parking lot lane and access roadway. The minimum width of a fire access road is twenty feet (20'). The minimum height of a fire lane is thirteen feet, six inches (13'6").

**Fire Lane** – A road or other passageway developed to allow the passage of fire apparatus. A fire lane is not necessarily intended for vehicular traffic other than fire apparatus. The minimum width of a fire lane is twenty feet (20'). The minimum height of a fire lane is thirteen feet, six inches (13'6").

## **REQUIREMENTS**

When required by the FM, approved signs for identification or other approved markings must be provided and maintained for fire apparatus access roads and prohibit their obstruction.

The FM may require that fire lanes for new and existing structures be established on private property, public property, public streets, alleyways, parking lots, driveways, or other roadways to provide access for fire suppression operations.

## **PROCEDURE**


Fire department access and fire lanes must be identified on private streets, or drives by use of the phrase **"NO PARKING - FIRE LANE"** and shall be designated by the use of one or more of the following:

- a. Approved SIGNS
- b. Approved RED CURBS, or
- c. Approved ROADWAY STRIPING (Two options)

Any approved combination of the above.

### **1. SIGNS**

- a. Must be eighteen (18") inches in height by twelve (12") inches in width.
- b. Lettering must be **red** on a white background and shall be no less than two and one-half inches (2 ½") in height with a one (1") inch width for "No Parking, Fire Lane."
- c. **"BY ORDER OF THE LHC FIRE MARSHAL"** and the Lake Havasu City Code Ordinance section must be located below the fire lane and lettering shall be five eights inches (5/8") in height and one-half inch (½") in width.

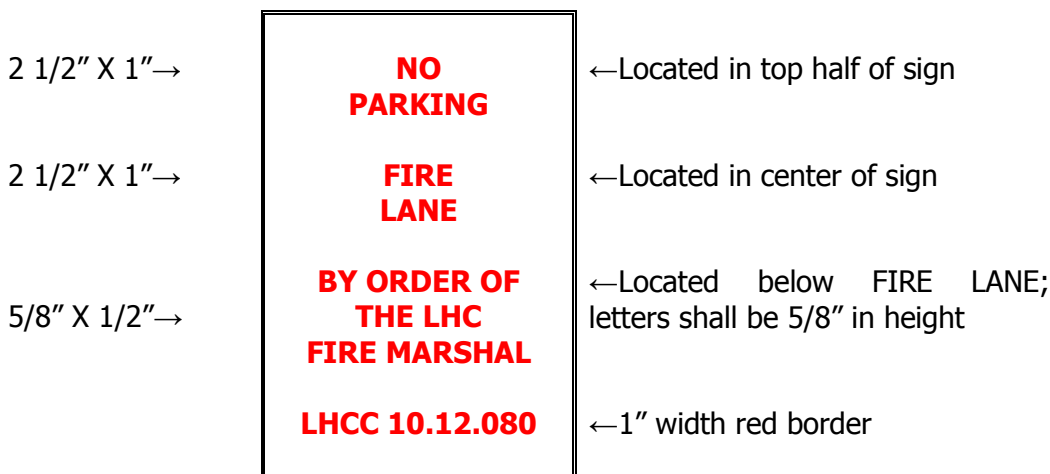

- d. Signs must be installed so that there is no less than seven (7') feet clear from the bottom of the sign to finished grade. Temporary signs must be approved by the Fire department prior to placement and use.
- e. The distance between signs must not exceed fifty (50') feet, and there must be a sign within five (5') feet of the beginning and end of the FIRE LANE.
- f. Installation and maintenance of signs located on private streets and drives must be the responsibility of the property owner.

### **2. RED CURBS**

- a. Curbing which is used in designating FIRE LANES must be painted Rustoleum Fire Safety Red, or equivalent.

- b. White lettering, no less than three (3") inches in height must be placed on the top and face of the red curbing, and must read, "NO PARKING - FIRE LANE."
- c. Such lettering must be located a maximum of thirty-five (35') feet apart and within five (5') feet from the beginning and end of the designated FIRE LANE.
- d. Installation and maintenance of red curbing located on private streets and drives is the responsibility of the property owner.

### **3. ROADWAY STRIPING**

#### **OPTION #1**

- a. Areas designated to be FIRE LANES where no curbs exist must be striped.
- b. Striping must consist of three inch (3") wide **red stripes** on a diagonal basis for the full width and length of the FIRE LANE.
- c. **White lettering** a minimum dimension of two (2") inches in width by twelve (12") inches in height, per letter, must read "**NO PARKING - FIRE LANE**" and must be painted within the striping.
- d. Such lettering must be located a maximum of thirty-five (35') feet apart and within five (5') feet of the beginning and end of the FIRE LANE.
- e. Installation and maintenance of roadway striping located on private streets and drives is the responsibility of the property owner. See illustration below.


**-OR-**

#### **OPTION #2**


- a. Fire lanes must be provided and maintained with fire lane striping that consists of a six inch (6") wide **red background stripe** with four inch (4") high **white letters** stating "**NO PARKING, FIRE LANE**" to be painted upon the red stripe every fifteen feet (15') along the entire length of the fire lane showing the exact boundary of the fire lane.
- b. Fire lane markings must be upon the vertical surface of the curb, unless otherwise approved by the FCO. See illustration below.

"NO PARKING-FIRE LANE" STANDARDS (diagrams not to scale)



### **4. FIRE LANE SIGN INSTALLATION**

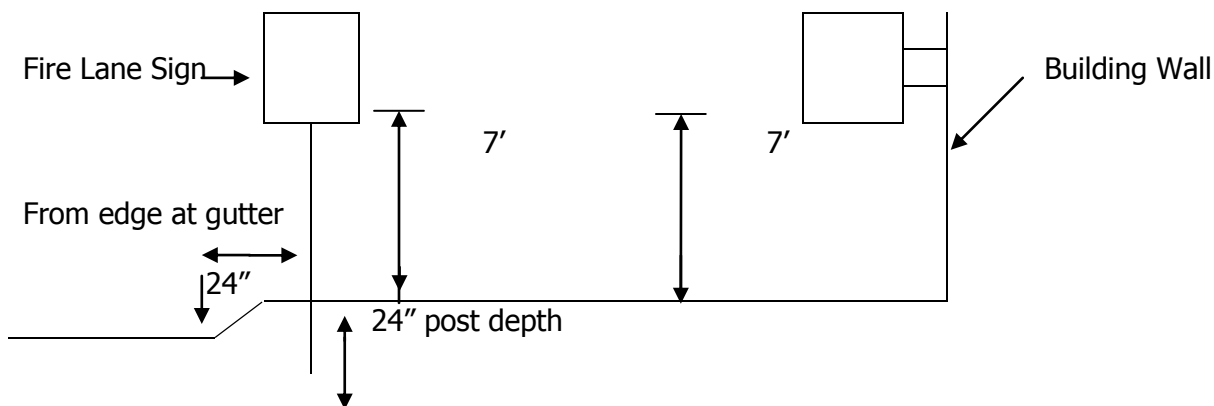

### **5. FIRE LANE SIGN PLACEMENT**

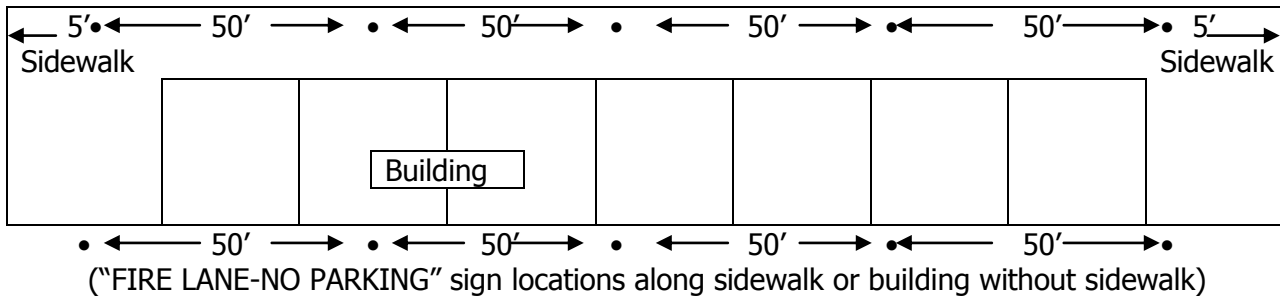


## 6. RED CURBS AND MARKINGS

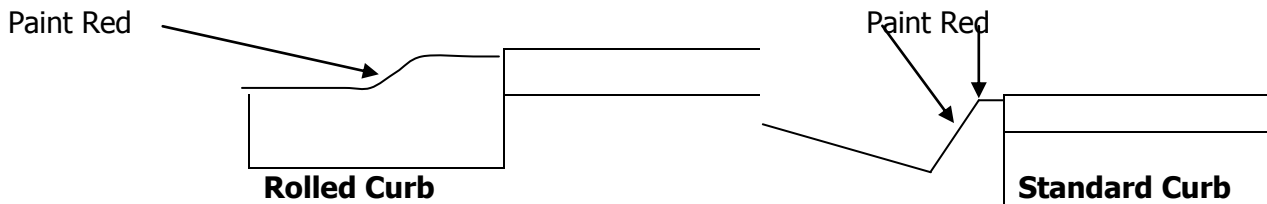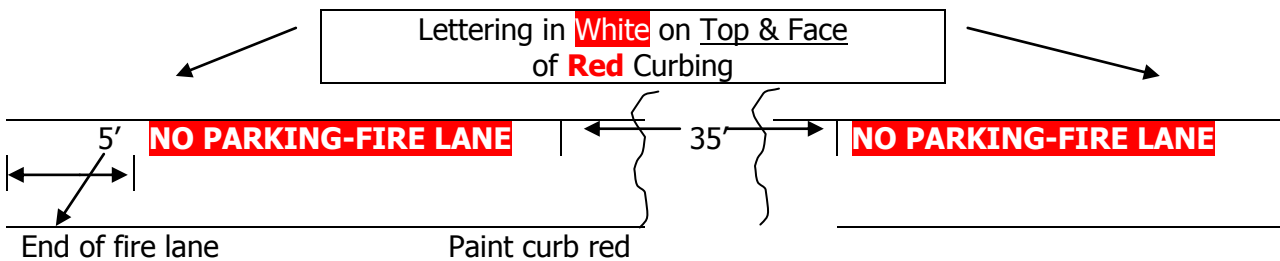


## 7. ROADWAY STRIPING OPTIONS

### OPTION #1

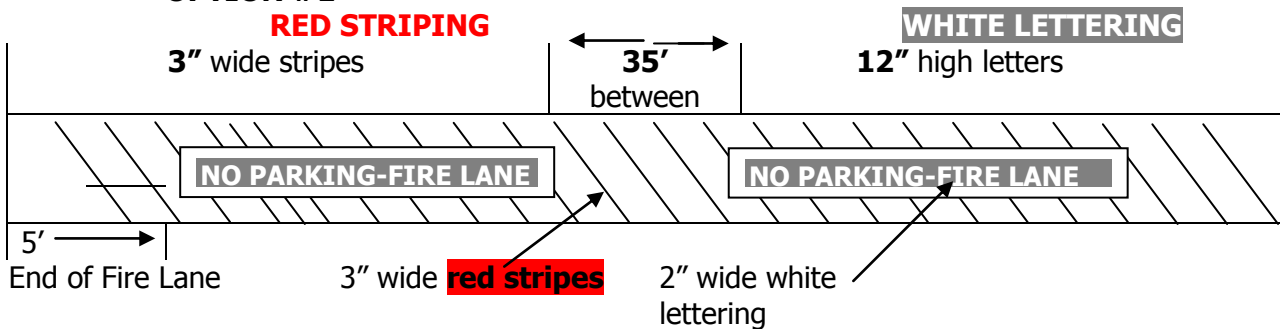

**OPTION #2**

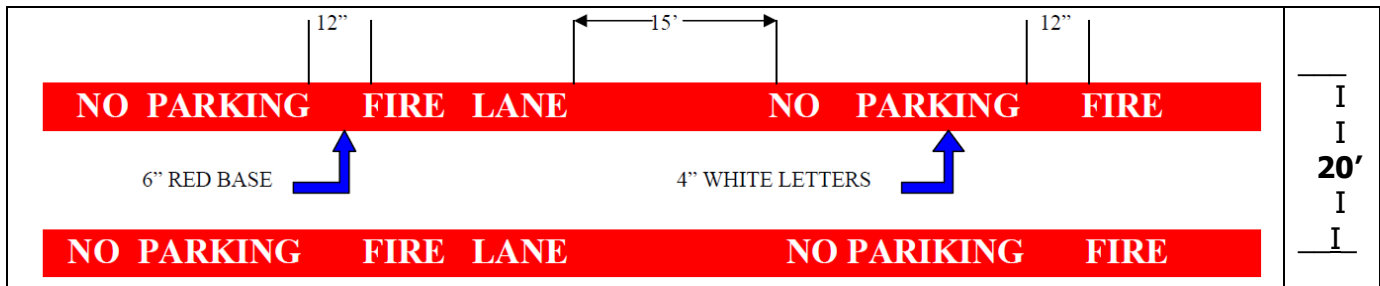

APPROVED:  DATE: May 24, 2016  
Scott Hartman, Fire Marshal